


ELEVATION
SCALE: 1/2"=1'-0"

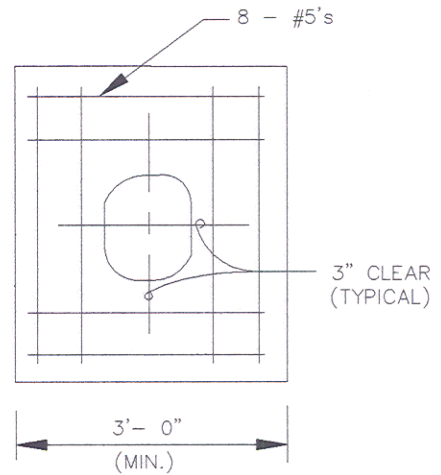

SECTION A-A
SCALE: 1/2"=1'-0"

CONCRETE ANCHOR

FOR 6", 8", 10", & 12" CAST AND
DUCTILE IRON AND PVC PIPES

NOTES:

1. $f_c = 4000$ PSI @ 28 DAYS.
2. ALL REINFORCING STEEL TO BE ASTM A-615 GRADE 60.
3. CARRY ALL BEARING SURFACES TO FIRM SUBGRADE. PLACE CONCRETE ANCHOR AGAINST DOWNGRADE SIDE OF BELL.
4. UTILIZE A LAYER OF ROOFING PAPER BETWEEN PIPE AND CONCRETE.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

[Signature] 6/29/95
DIRECTOR OF DEVELOPMENT SERVICES DATE

[Signature] 6/29/95
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

CONCRETE ANCHOR

REVISIONS:

B
1.08